Tech Support (888)-699-6067 7am to 6pm CST (M-F)

Revision Date: 12/12/2024

Subject: E466 Error Code **Models:** DVM, Chiller

Title: DC Link Voltage Error in Inverter #1 PCB

Issue

DC Link Voltage Error in Inverter 1 – DC link voltage error (Inverter PCB is not seeing the correct DC link voltage)

Always refer to wiring diagram for specific model. Use the link below for a model search and see the technical data book for the wiring diagram. https://www.samsunghvac.com/downloads

Troubleshooting Steps 230V Heat Pump and Heat Recovery Diagnostics

- 1. Check the Incoming Voltage (208/230Vac ± 10%)
- 2. Power the unit OFF for 15-20 minutes before continuing to step 3
- 3. Check Fuses on EMI PCB
- Remove the wires on the Reactor coil and ohm the Reactor (resistance value should be less than 5 ohms, open to ground on each leg)
- 5. Disconnect DC Link Voltage connector from the FAN PCB (leave connected to Inverter PCB)
- Move the disconnected end of the DC Link Voltage harness to a safe location so voltage can be tested from White to Yellow when power is applied.
- 7. Restore power to unit and check for proper DC Link Voltage


DC Link voltage is sent from the Inverter PCB to the Fan PCB for both 230 & 460V Heat Pumps)


DC Link Voltage Connector (Yellow to White Wire)




Example:

Incoming Voltage x 1.41 = DC Link Voltage 230Vac x 1.41 = 324.3 Vdc (DC Link Voltage) 460Vac x 1.41 = 648.6 Vdc (DC Link Voltage)

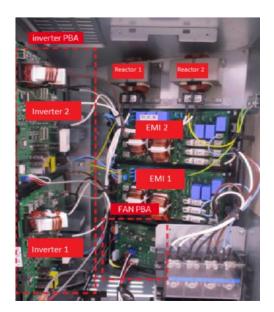







RESULTS

- ☐ If incoming voltage is incorrect, correct supply voltage (208/230 Vac ± 10%)
- If EMI PCB has an open fuse, replace the EMI PCB
- If the Reactor is open or short to ground, replace the Reactor
- ☐ If DC link voltage is accurate, replace Inverter #1 PCB (DC link voltage sensor in Inverter #1 is faulty)
- ☐ If supply power, EMI Fuses, and Reactor test within range, but DC link voltage is under 150Vdc, replace Inverter 1 and Fan PCB




** Before reconnecting wire harnesses or DC link voltage, leave the unit powered OFF for 15 – 20 min**

460V Heat Pump and Heat Recovery Diagnostics (Reference Pictures on Page 1)


- 1. Check Incoming Voltage (460Vac ± 10%)
- Check the Voltage at the Transformer (Primary 460V, Secondary 230V)

The Transformer is in the lower left side of the unit near compressor 1. It is not located in the control board cabinet.

- Power the unit OFF for 15-20 minutes before continuing to step 4
- 4. Check the fuses on the EMI PCB
- Remove the wires on the Reactor coil and ohm the Reactor (resistance value should be less than 5 ohms, open to ground on each leg)
- Disconnect DC Link Voltage connector from the FAN PCB (leave connected to Inverter PCB)
- Move the disconnected end of the DC Link Voltage harness to a safe location so voltage can be tested from White to Yellow when power is applied.
- 8. Restore power to the unit and check DC Link Voltage

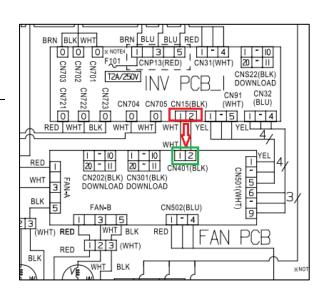

460V to 230V Transformer

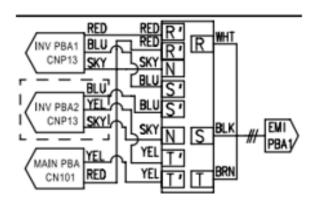

SAMSUNG

SERVICE GUIDES E466 ERROR CODE

Tech Support (888)-699-6067 7am to 6pm CST (M-F)

RESULTS

If any power is missing, correct supply power (460Vac ± 10%)
If EMI PCB has an open fuse, replace the EMI PCB
If the Reactor is open or short to ground, replace the Reactor
If DC link voltage is accurate, replace Inverter #1 PCB (DC link voltage sensor in Inverter #1 is faulty)
If supply power, EMI Fuses, and Reactor test within range, but DC link voltage is under 150Vdc, replace Inverter 1 and Fan PCB



** Before reconnecting wire harnesses or DC link voltage, leave the unit powered OFF for 15 – 20 min**